


## AIRIUS MOUNTING GUIDELINES - PUREAIR SERIES - Model 10, 15, 25 (Long & Short Nozzle)

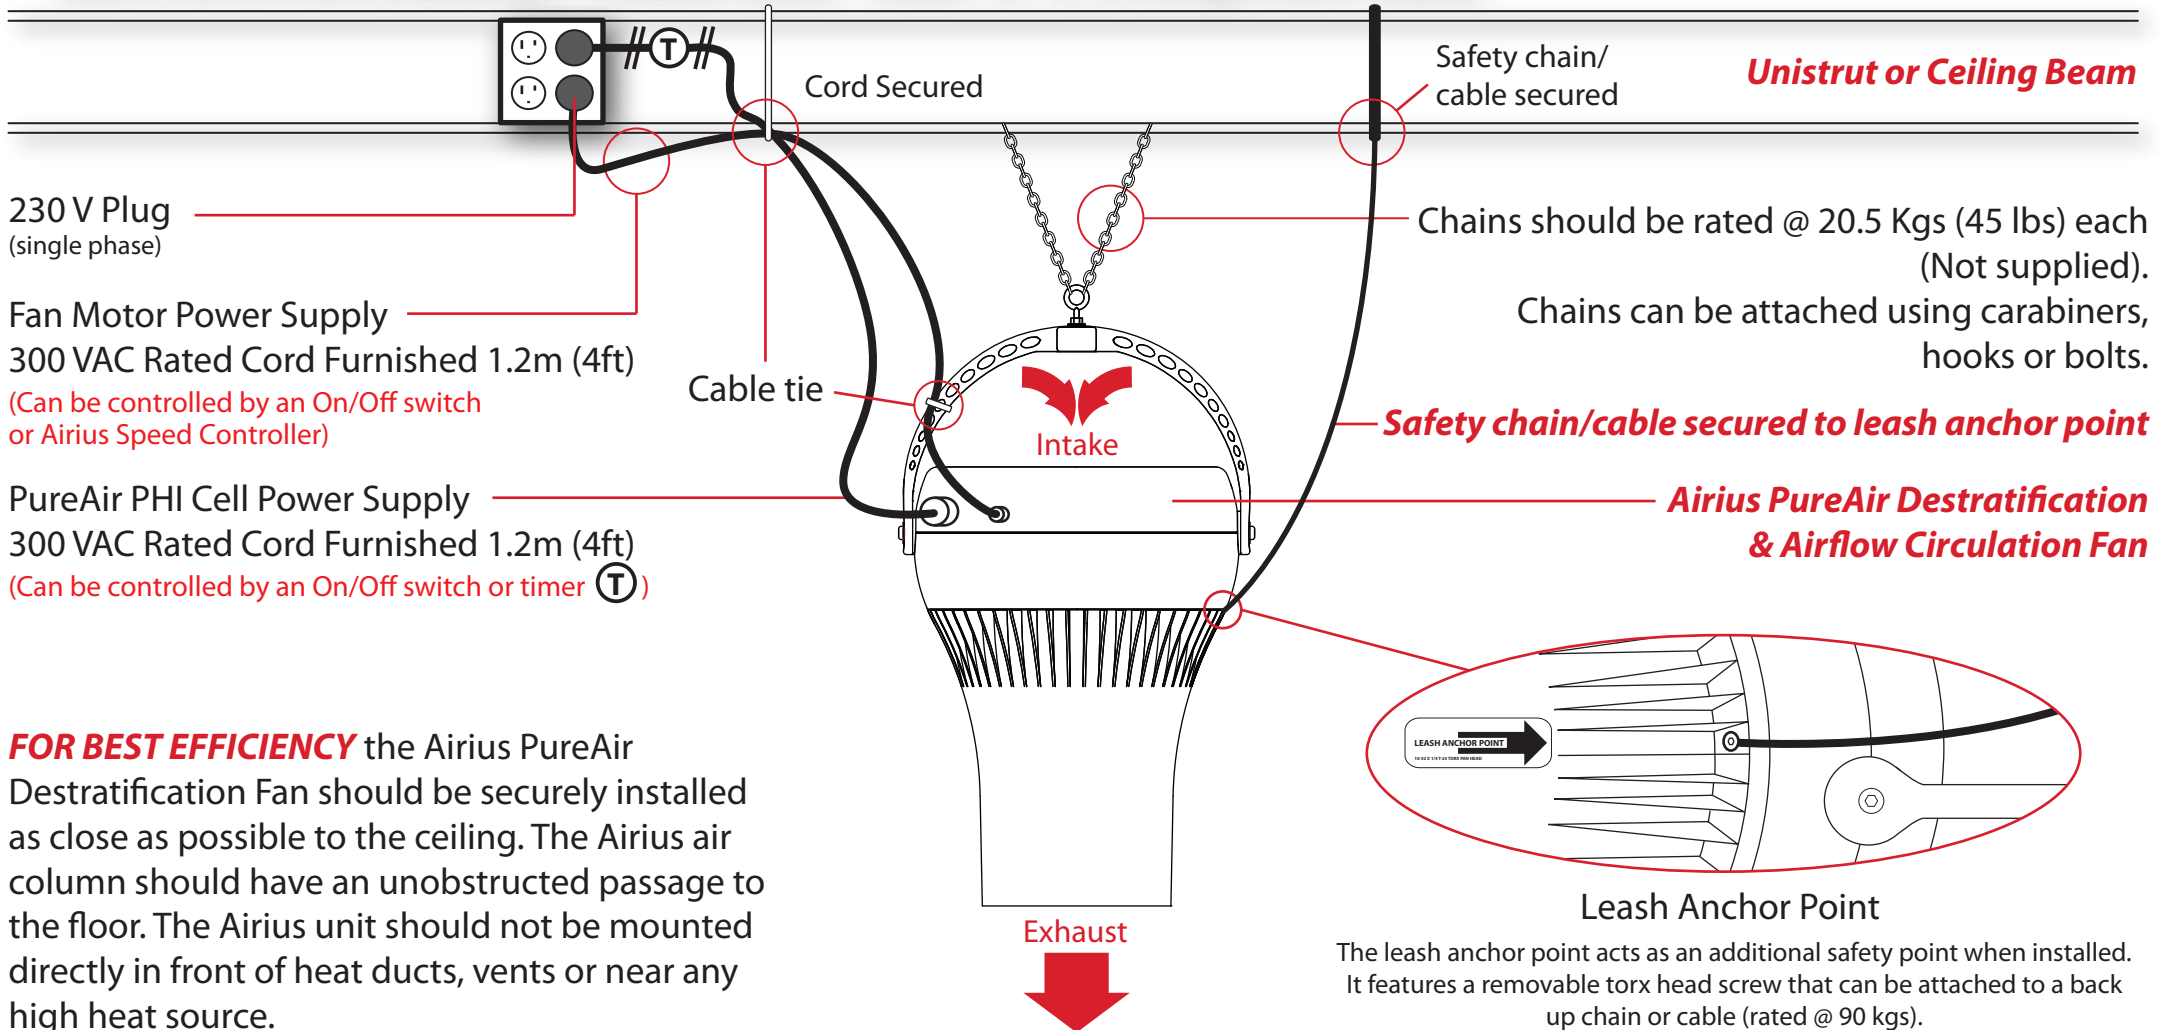

**FOR BEST EFFICIENCY** the Airius PureAir Destratification Fan should be securely installed as close as possible to the ceiling. The Airius air column should have an unobstructed passage to the floor. The Airius unit should not be mounted directly in front of heat ducts, vents or near any high heat source.

The leash anchor point acts as an additional safety point when installed. It features a removable torx head screw that can be attached to a back up chain or cable (rated @ 90 kgs).

## AIRIUS MOUNTING GUIDELINES - PUREAIR SERIES - Model 10, 15, 25 (Long & Short Nozzle) - Angled

